


**LightningMaster**  
Corporation

# COPPER GROUNDING PLATE LM-GP-1224 (12"X24")

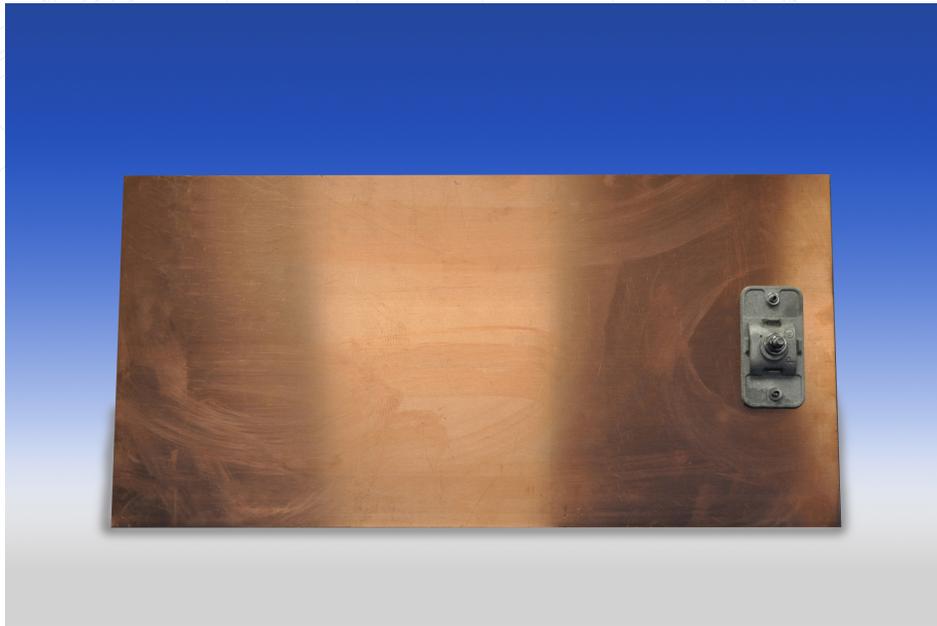

## DESCRIPTION

SRAT TYP STAG PATTERN  
AROUND CATWALK ON  
TANK SHELL AND HANDRAIL

- 0.032 (1/32") thick high conductivity copper sheet with UL 96 Listed bonding plate
- 1/32" meets minimum thickness requirements for UL 96
- Custom sizes are available upon request

## APPLICATION:

- NFPA 780 4.13.6.2 - The ground plate electrode shall be buried not less than 18" below grade.
- NFPA 780 4.13.8.1.1 - Where topsoil is less than 18" it shall be permitted to provide a ground ring electrode, radials, and/or ground plate electrodes buried at the maximum depth of topsoil available. (Use LM-GP-1224 series)

*This drawing is confidential and all rights are reserved. It shall not be reproduced, copied, lent or disposed of directly or indirectly, nor used for any other purpose than that for which it is specifically furnished*

2100-A Palmetto St., Clearwater, FL 33765  
800-749-6800

**lightningmaster.com**